


STEPS FOR MANUFACTURED HOMES

1. STEPS ARE REQUIRED AT EACH DOOR. THEY NEED TO BE THE WIDTH OF THE DOOR OR WIDER. THEY NEED TO BE STABLE AND STURDY AND THE TOP STEP NEEDS TO BE AT FINISHED FLOOR AND BOTTOM STEP AT 7" ABOVE GRADE OR LESS (BUT AT LEAST 4" ABOVE GRADE)

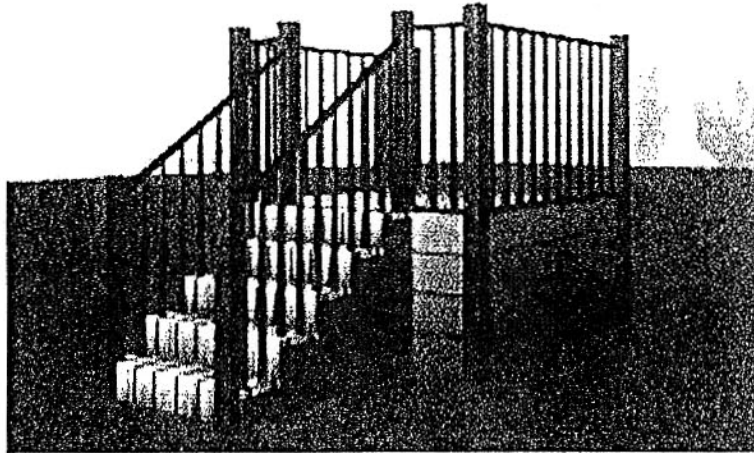

NOTE : THERE ARE OTHER RAILING SYSTEMS THAT MEET CODE THAN ABOVE PICTURE

STEPS ARE TO BE UNIFORM TOP TO BOTTOM (SAME PROFILE).

RISE OF STEP TO BE 7" MAX.

RUN OF TREAD TO BE 11" MIN.

NOSING IS ALLOWED UP TO 1.25"

RISER OPENING LESS THAN 6"

GUARD RAILING HIEGHT MIN 36" FOR RESIDENTIAL AND MIN 42" FOR COMMERCIAL USES

REQUIRED FOR ALL OPEN SIDES

REQUIRED WHERE 30" OF ELEVATION ABOVE GRADE

STAIR RAIL MIN 34" TO 38" HIGH MEASURED FROM TOE (NOSE) OF STEP

THE OPENINGS IN THE RAILINGS SOULD NOT ALLOW THE PASSAGE OF A 4 INCH DIAMETER SPHERE

RAILING SYSTEMS SHALL NOT BE CLIMBABLE OR CREATE A LADDER EFFECT

EXCEPTION

WHEN ORNAMENTAL RAILINGS ARE USED (ALLOWED ONLY WHERE CODE COMPLIANT RAILINGS ARE NOT REQUIRED) THEN THE OPEN SPACES SHALL BE LESS THAN 4" OR GREATER THAN 9"